



TECHNICAL GUIDE



YORKSHIRE
COPPER TUBE

Ask for it by name

www.yorkshirecopper.com

This page has been intentionally left blank

Contents

1 Introduction	
1.1 Technical Expertise	1-1
1.2 Technical Department Contact Details	1-1
1.3 Copper Tube Development	1-2
2 Policy Statements	
2.1 Quality Policy Statement... ..	2-1
2.2 Environment, Health & Safety Policy Statement	2-2
3 Installation Guide	
3.1 Installation of Plastic Covered Tube	3-1
3.2 Flushing and Avoidance of Stagnation	3-4
3.3 Disinfection	3-5
3.4 Cold Bending	3-6
3.5 Use with Fittings... ..	3-8
3.6 Use of Fluxes	3-10
3.7 Burying Tubes in Contaminated Ground	3-11
3.8 Lagging of Pipework... ..	3-12
3.9 Medical Gas Tubes	3-13
4 Technical Data	
4.1 Pipe Sizing, Flow Rates and Pressure Drops	4-1
4.2 Tube Support Distances	4-3
4.3 Thermal Expansion and Contraction	4-4
4.4 Pressure Ratings and the Effect of Annealing... ..	4-5
4.5 Suitability of Copper with Various Materials	4-6
5 Product Specifications	
5.1 Copper Tubes	5-1
5.2 Plastic Covered Tubes	5-2
5.3 Chrome Plated Tubes	5-3
5.4 Medical Gas Tubes	5-4
6 Approvals	
6.1 Quality System	6-1
6.2 Kitemark – BS EN 1057 copper tubes	6-2
6.3 Kitemark – BS EN13348 medical tubes	6-5
6.4 EC Certificate of Conformity (CE Mark)	6-8
7 Guarantee	
7.1 YCT 25 Year Guarantee	7-1
7.2 YCT 30 Year Guarantee	7-2
8 COSHH	
8.1 Material Safety Data Sheet	8-1
9 References	
9.1 References	9-1

Section 1 - Introduction

1.1 Technical Expertise

The roots of Yorkshire Copper Tube stretch back to the time of the industrial revolution. During this period we have accumulated an unrivalled wealth of knowledge concerning the use of copper tubing for a diverse range of applications ranging from the conveyance of liquid nitrogen, at temperatures of -196°C, to steam, at temperatures up to +205 °C.

A lot of this knowledge is included in this Technical Data Guide, however it is impossible to cover all eventualities in such a publication. If you cannot find the information you require please feel free to contact our Technical Services Department by simply picking up a telephone or via our website.

Throughout this guide superscript references are included to refer to data sources. A full list of these references is included in Section 9.

1.2 Technical Department Contact Details

<u>Service</u>	<u>Telephone</u>
Application Enquiries After Sales Service COSHH Environmental Matters	+44(0)151-545-5107
Quality Systems Product Approvals Product Certification	+44(0)151-545-5098
<u>Facsimile</u>	+44 (0)151-545-5018
<u>E-mail</u>	technical@yct.com
<u>Web-site</u>	www.yorkshirecopper.com

1.3 Copper Tube Development

The first recorded use of copper for conveying water goes back to a conduit that has been dated to 2,750 B.C. discovered at Abusir in Egypt. Copper water pipes and cisterns were also widely used by the Romans and good examples of copper plumbing can still be seen at the archaeological site of Herculaneum, which was uniquely preserved by the eruption of Vesuvius in 79 A.D. Historically copper tubing was expensive and only installed in prestige buildings. It was not until the development of modern types of fittings in the 1930's, which lead to the introduction of light gauge copper tubes, that copper plumbing systems became highly competitive with other materials.

In 1996 the latest specification for copper tubes, EN 1057, was adopted across Europe. In the UK it was published as BS EN 1057:1996, *"Copper and copper alloys - Seamless, round copper tubes for water and gas in sanitary and heating applications"*. It replaced the previously familiar standard BS 2871 Part 1: 1971, *"Copper and Copper Alloys - Tubes - Copper tubes for water, gas and sanitation"*. In 2006, EN 1057 was further revised to support the essential requirements of the EU Construction Products Directive (CPD) 89/106/EEC and the EU Pressure Equipment Directive (PED) 97/23/EC.

In drawing up this standard, the opportunity was taken to rationalise tube sizes across Europe. At first glance to UK users, familiar with BS 2871 Part 1, the changes to the standard may have seemed quite large and the available options quite confusing. Yorkshire simplified this process by branding their products as Yorkex, Kuterlon and Minibore in line with Tables X, Y and W in BS 2871 Part 1.

Under BS EN 1057, temper condition (material strength) is designated with an 'R' number, the higher the number indicating a stronger material. Soft condition is denoted R220, half hard R250 and hard R290. Because of the variety of sizes both diameter and thickness should be specified when ordering to BS EN 1057. For example when ordering half hard copper tube with an outside diameter of 15mm and a thickness of 0.7mm (formerly 15mm BS 2871 Part 1 Table X tubing) the official designation is EN 1057 – R250 – 15 x 0.7mm. More simply it can be ordered as 15mm Yorkex.

The following tables show the relationship of the current Yorkshire range with BS EN 1057 and BS 2871 Part 1.

Yorkex - Half Hard Range			Yorkex – Hard Range		
Size mm (od x wall)	EN 1057 Designation	BS 2871 Part 1 Designation	Size mm (od x wall)	EN 1057 Designation	BS 2871 Part 1 Designation
6 x 0.6	6 x 0.6mm – R250	6mm Table X	35 x 1.0	35 x 1.0mm – R290	New size
8 x 0.6	8 x 0.6mm – R250	8mm Table X	35 x 1.2	35 x 1.2mm – R290	35mm Table X ►►
10 x 0.6	10 x 0.6mm – R250	10mm Table X	42 x 1.0	42 x 1.0mm – R290	New size
12 x 0.6	12 x 0.6mm – R250	12mm Table X	42 x 1.2	42 x 1.2mm – R290	42mm Table X ►►►
15 x 0.7	15 x 0.7mm – R250	15mm Table X	54 x 1.2	54 x 1.2mm – R290	54mm Table X ►►►
22 x 0.9	22 x 0.9mm – R250	22mm Table X	66.7 x 1.2	66.7 x 1.2mm – R290	66.7mm Table X ►►►
28 x 0.9	28 x 0.9mm – R250	28mm Table X	76.1 x 1.5	76.1 x 1.2mm – R290	76.1mm Table X ►►►
35 x 1.2	35 x 1.2mm – R250	35mm Table X	108 x 1.5	108 x 1.5mm – R290	108mm Table X ►►►
42 x 1.2	42 x 1.2mm – R250	42mm Table X	133 x 1.5	133 x 1.5mm – R290	133mm Table X ►►►
54 x 1.2	54 x 1.2mm – R250	54mm Table X	159 x 2.0	159 x 2.0mm – R290	159mm Table X ►►►

Kuterlon - Straight Tube Range			Minibore – Coil Range		
Size mm (od x wall)	EN 1057 Designation	BS 2871 Part 1 Designation	Size mm (od x wall)	EN 1057 Designation	BS 2871 Part 1 Designation
6 x 0.8	6 x 0.8mm – R250	6mm Table Y	6 x 0.6	6 x 0.6mm – R220	6mm Table W
8 x 0.8	8 x 0.8mm – R250	8mm Table Y	8 x 0.6	8 x 0.6mm – R220	8mm Table W
10 x 0.8	10 x 0.8mm – R250	10mm Table Y	10 x 0.7	10 x 0.7mm – R220	10mm Table W
12 x 0.8	12 x 0.8mm – R250	12mm Table Y			
15 x 1.0	15 x 1.0mm – R250	15mm Table Y			
22 x 1.2	22 x 1.2mm – R250	22mm Table Y			
28 x 1.2	28 x 1.2mm – R250	28mm Table Y			
35 x 1.5	35 x 1.5mm – R290	35mm Table Y ►►►			
42 x 1.5	42 x 1.5mm – R290	42mm Table Y ►►►			
54 x 2.0	54 x 2.0mm – R290	54mm Table Y ►►►			
66.7 x 2.0	66.7 x 2.0mm – R290	66.7mm Table Y ►►►			
76.1 x 2.0	76.1 x 2.0mm – R290	76.1mm Table Y ►►►			
108 x 2.5	108 x 2.5mm – R290	108mm Table Y ►►►			

Kuterlon – Coil Range		
Size mm (od x wall)	EN 1057 Designation	BS 2871 Part 1 Designation
15 x 1.0	15 x 1.0mm – R220	15mm Table Y coil
22 x 1.2	22 x 1.2mm – R220	22mm Table Y coil

►► Hard temper equivalent size.

Section 2 – Policy Statements

This section details copies of commonly requested policies covering areas of quality, the environment and health and safety. The Company also operates to numerous other policies covering various business activities (e.g. employment policy, disaster recovery policy, etc.).

2.1 QUALITY POLICY STATEMENT

Yorkshire Copper Tube is dedicated to the manufacture of copper tubes to national and international standards used extensively in many fields of building construction and throughout the general and civil engineering industries.

The quality objectives of the company are:

- ◆ continually to improve upon levels of customer satisfaction,
- ◆ to manufacture products to meet the requirements of internal and external specifications,
- ◆ to operate and develop an effective Quality Management System

To this end a fully documented Management System has been established which covers all activities and functions concerned with the attainment and continual improvement of quality. The system is based on and meets the requirements of ISO 9001:2008.

The Company Quality Manual describes the organisation and operation of the quality assurance programme and is issued with the full support and commitment of the Senior Management of the Company who undertake to ensure that the Company Quality Policy is understood, implemented and maintained at all levels in the organisation.

Documented procedures supporting the Management System detail responsibilities for carrying out the work and it is a mandatory requirement that Yorkshire Copper Tube personnel at all levels comply with the policies, systems and procedures described.

The policies and procedures will be reviewed at regular intervals.

Ref. - ISO 9001: 2000, Clause 5.3

2.2 ENVIRONMENT, HEALTH AND SAFETY POLICY STATEMENT

It is the policy of Yorkshire Copper Tube to:

- ◆ Conduct its activities in a responsible manner, having due regard to their impact on the safety, the environment and the community within which the company operates.
- ◆ Promote a continued improvement to the Occupational Health, Safety and Welfare of everyone associated with its operations.
- ◆ Create an injury free workplace where safe acts are recognised and unsafe acts are addressed consistently and promptly.
- ◆ Comply with or exceed all legal and other requirements.
- ◆ Establish Environment, Health and Safety objectives and targets, track our performance and communicate our progress effectively with all employees and stakeholders.

The Plant Director is primarily responsible for meeting the requirements of this Policy and shall ensure all reasonable steps are taken to do so.

Directors, Managers & Co-ordinators are responsible for:

- ◆ Ensuring Environment, Health and Safety are an integral part of production, maintenance and quality on a daily basis.
- ◆ Preventing injury and illnesses by ensuring full adherence with Company Rules and Safe Systems of Work, each level being accountable to the one above and responsible for the level below.

The Company expects each employee to assume individual responsibility for working safely and in an environmentally responsible manner at all times.

This will include:

- ◆ Following all Company Rules, Procedures and co-operating with all reasonable requests to enable the Company to fulfil its legal duties.
- ◆ Taking personal responsibility for our own safety and health and the safety of our colleagues and business partners.
- ◆ Reporting hazards and unsafe behaviours promptly and all incidents and accidents immediately.
- ◆ Embracing safe behaviours.
- ◆ Looking for opportunities to reduce waste and emissions in our workplaces to protect the environment and save money.
- ◆ Continuously improving the health, safety and efficiency of our workplace.

Resources will be made available to meet this objective in the form of instruction and training. The Company recognises people as the most critical element to the success its performance and will ensure consultation with all levels through works and departmental committees, notices and emails on a regular basis.

This Policy and associated Procedures will be reviewed / revised periodically to reflect legislative changes and brought to the attention of all employees and Contractors.

Section 3 – Installation Guide

3.1 Installation of plastic covered tube

Experienced, time-served, plumbers are familiar with the installation of copper tube systems since they have been used for very many years and are considered the standard material against which all others are measured. The Kuterlex and Kuterlex Plus products are increasing in use and some comments on their installation follow.

Kuterlex and Kuterlex Plus tubes are Yorkshire copper tubes sheathed in a continuous plastics cover. The covering on Kuterlex Plus has air channels on its internal surface. Although Kuterlex and Kuterlex Plus are primarily designed for protection against external aggressive materials, the Kuterlex Plus cover reduces heat loss from buried hot service tube and condensation along surface fixed cold service pipework. Kuterlex Plus tubes are particularly recommended for domestic hot water and heating services, especially if the pipes are to be buried in plaster or screed, or for cold water services exposed to conditions of high humidity where condensation may be a problem.

Kuterlex and Kuterlex Plus are primarily intended for internal / underground applications and outdoor surface fixing of these products is therefore not recommended.

3.1.1 Maintaining the Protection

To maintain protection any breach made in the plastic cover must be made good to ensure the protective properties are maintained. To maintain a continuous protective coating where the plastics cover has been cut back exposing the copper, for making joints for instance, the bare copper tube (and fitting) should be carefully and completely wrapped with an adhesive polythene or PVC waterproof tape: see Installation Instructions 3.1.5. Moisture should be prevented from entering the channels in the plastics coating of Kuterlex Plus where it has been terminated, breached or damaged. The best way to do this is by the spiral, overlapping application of a suitable waterproof adhesive plastics tape over at least the last 25mm of intact Kuterlex Plus plastics covering and at least a similar length of immediately adjacent bare copper pipe.

3.1.2 Taking Care of Expansion and Contraction

For the relatively short tube runs encountered in domestic installations, thermal expansion and contraction is normally accommodated by bends, elbows, off-sets, etc. and no special precautions are generally required. However, on longer straight tube runs (usually in excess of 10 metres) consideration should be given to the use of expansion devices such as expansion bellows or loops. Where burying in concrete is allowed, Kuterlex Plus helps to take care of thermal expansion and contraction.


Where pipework carrying hot water is buried in concrete, precautions need to be taken to protect the tubing from both external corrosion and the effects of thermal movement. In such circumstances Kuterlex Plus, by virtue of the air channels formed on the inside surface of the plastics coating, not only provides external protection and a degree of thermal insulation but also, when laid in the manner recommended, has a greater ability to absorb the stresses imposed by thermal movement.

The coefficient of linear expansion of copper is 16.8×10^{-6} per °C. This means, for example, that a 10m length of copper tube, irrespective of diameter, thickness or temper condition (hardness), will increase in length by 10.2mm when its temperature is increased by 60°C (a typical value for a central heating system). On cooling down, the tube will contract to its original length. If this thermal movement is not allowed for in design and installation, considerable cyclic stress will be imposed on the tubing and/or associated fittings. These stresses can lead to either premature failure of the joint (i.e. a so-called “pulled joint”) or fatigue failure of the tube itself. To avoid this, ideally fittings should not be buried in concrete. Clearly, if firmly buried in screed the branch of a tee will become a fixed point and this situation should be avoided wherever possible. If burying the system in concrete is unavoidable, however, any joints such as tees, elbows, etc., should be installed so that they are free to move when the pipework system expands and contracts. For example, a tee joint and approximately one metre of its branch should be laid in a duct filled with a material that will “give”

(e.g. vermiculite) and covered with a duct cover. This will normally be sufficient to absorb the stresses imposed on the branch.

When soft coiled Kuterlex Plus tubing is properly installed, in a serpentine (snake-like) manner, the copper tube is free to move within the castellated plastics sleeve. When in concrete, the plastics sleeve is fixed in position but tube movement from expansion and contraction is accommodated within the channels of the sleeve.

When installing the tube in a serpentine manner, it is useful to regard each segment of the “snake” as an arc in which each change of direction can then accommodate about 1mm of expansion. Thus, as a guide, we would recommend that the “wavelength” of the “snake” should be no more than about two metres, i.e. one metre between the “nodes”. The minimum displacement of a “snaked” Kuterlex Plus line is considered to be one full diameter of the pipe size concerned, although more commonly two to three diameters is the distance used.

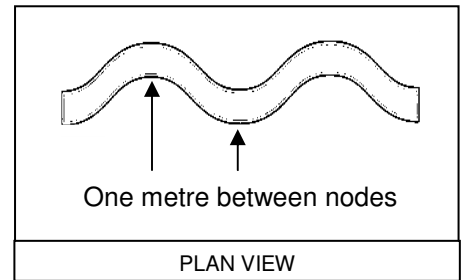

At corners of a buried installation, a bend should be put in the tube, rather than an elbow fitting. A smooth bend, of generous radius, is better able to absorb stresses than a bend of tight radius but either is preferable to an elbow, which becomes an anchor point only slightly less rigid than a tee.

Similarly, where the tubing leaves the screed to connect to radiators etc., a bend of generous radius is preferred. The plastics sleeve should be continued almost up to the radiator connection since, if it is cut back to floor level, there is a risk that concrete will adhere to the bare copper tube and create an anchor point.

3.1.3 Burying in Plaster, Screed and Concrete

Soft temper (R220) copper tubing, made to the requirements of BS EN 1057, is the preferred material for this type of application. This pipework is supplied in long length coils, which usually avoids any need for fittings below ground level. Such tubing is available in 8 to 22mm sizes as Kuterlex Plus.

Where pipework is fitted within ducted systems, i.e. where the pipework is surrounded by air and not directly embedded in concrete, Yorkex straight length material, to BS EN 1057 R250 / R290 can be used. Indeed, in such a system the pipework is free to move in the surrounding air space and therefore acts in a manner similar to surface-fixed tubing. However, some construction materials may contain contaminants which are aggressive to copper; we do not therefore recommend that bare copper tubing be embedded directly into concrete or plaster. Instead, tubing fixed in such locations should be protected by a factory-applied plastics covering such as that provided by Kuterlex and Kuterlex Plus.

It should also be borne in mind that the minimum recommended depth to which plastics coated pipework should be buried in screed or plaster is 50mm, measuring from the top of the tube in situ. For tubing embedded in plaster, this may require chasing the pipework into the wall.

Before going ahead with any design or installation work, it is recommended that the view of the local water supplier on the subject of “accessibility of pipework” is established since the interpretation and application of the water supplier regulations may vary from region to region.

3.1.4 Good Practice


During installation, it is suggested that the end of the tube be nipped or covered to prevent dust or dirt entering. A further tip, when Kuterlex Plus is used for a central heating system, is to mark with coloured tape or pencil the flow and return tubes so that at the manifold and radiator valve connections, there is a clear indication which pipes carry the flow and which the return. This is particularly useful where solid floors are to be laid.

3.1.5 Jointing Instructions for Kuterlex and Kuterlex Plus

When jointing with all types of fittings, the tube should be cut with a pipe cutter or with a fine tooth hacksaw and deburred inside and outside.

Before jointing soft temper tubing with fittings it is essential that a re-rounding tool be used.

3.1.5.1 Capillary Jointing

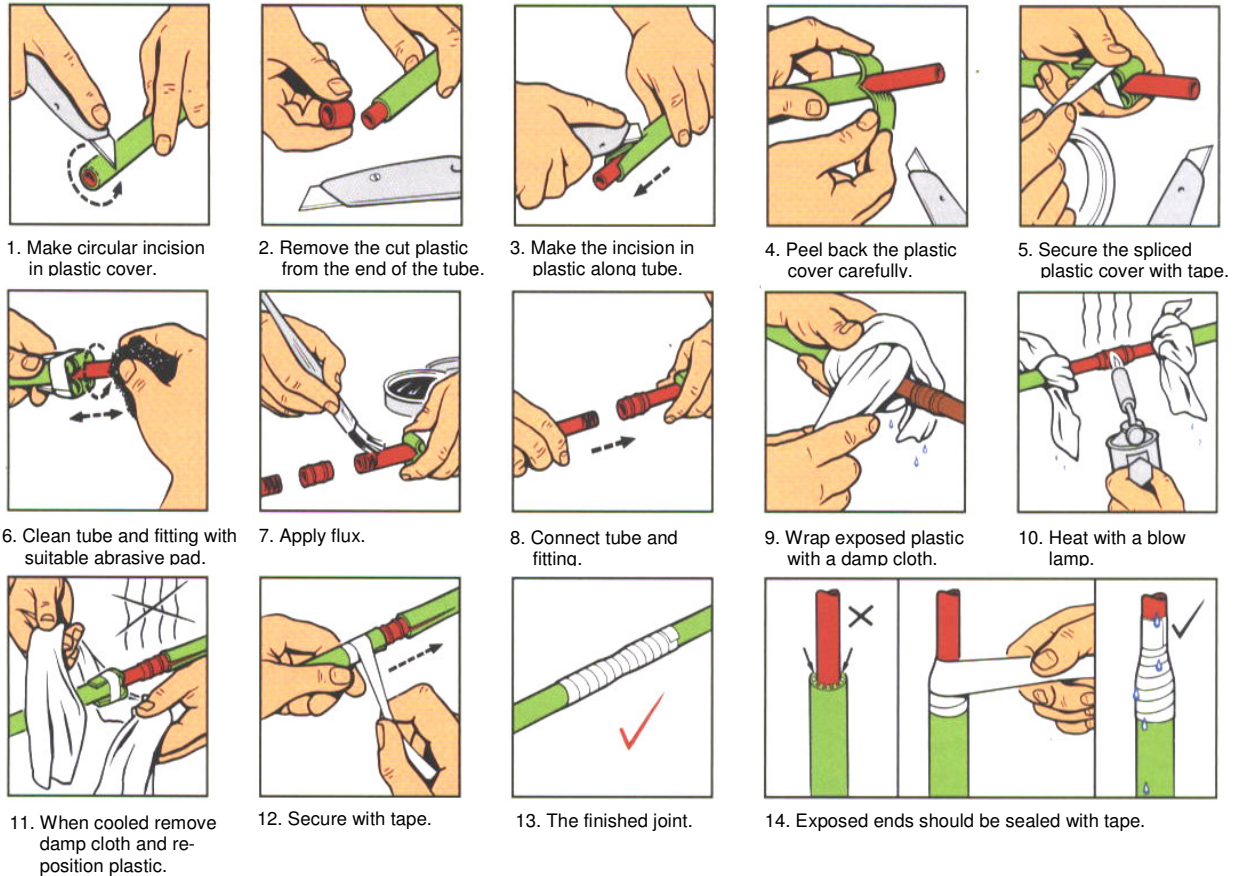

When using capillary fittings, the plastics cover should be cut lengthways and folded back about 100mm and care should be taken not to allow the flame of the torch or blowlamp to come into contact with the covering. It is recommended that the end of the plastic and part of the exposed copper be wrapped with a wet rag, to prevent over-heating and damage of the cover. The use of excess flux should be avoided and any residual flux should be removed to prevent unsightly stains or in extreme cases corrosion of the pipework.

When joints are complete it is essential that any cut and folded plastics are returned to their original position and the lengthways cut and any exposed pipework and fitting are carefully and completely protected by spirally taping the joint with self-adhesive polyethylene or PVC waterproof tape. Moisture should be prevented from entering the channels in plastics coverings at positions where the covering has been terminated by wrapping in a similar manner.

3.1.5.2 Heat Free Jointing

When using heat free fittings, sufficient plastic cover should be removed to allow insertion of the tube up to the tube stop (see pictures 1 & 2 above).

When using 'O' ring seal fittings, such as in push-fit or press-fit fittings, care must be taken when removing the plastics covering not to create a lengthways score mark on the copper where the fitting will be placed. Such a score could prevent the 'O' ring from making a complete seal.

When the joint is complete, the exposed pipework must be completely protected by spirally wrapping the jointed region with waterproof, adhesive, plastic tape (see pictures 12 and 13 above). Exposed ends should also be protected by wrapping in a similar manner (see picture 14 above).

3.2 Flushing and Avoidance of Stagnation

BS EN 806-4⁽²⁾, Section 6.2.1 states that; *“The drinking water installation shall be flushed with drinking water as soon as possible after installation and pressure testing and immediately before commissioning. Cold and hot water pipes shall be flushed separately. The water used for the flushing procedure shall be drinking water. It shall be taken into account that particles in the water can damage the installation (corrosion, disfunctioning). To prevent this, a mechanical filter in accordance with EN 13443-1 (no particles $\geq 150 \mu\text{m}$) shall be used”.*

All water services/heating systems should be **thoroughly** flushed with clean water as soon as possible after completion to remove foreign matter including filings, flux residues etc. Water velocity should be at least 2m/s and flushing should continue until the discharge water is completely clear. The water in the system should be changed at least 20 times during flushing. It should be borne in mind that simply filling a system and then draining down does not constitute a flush and, in most cases, will serve merely to move extraneous matter from one point in the pipework installation to another.

The purpose of flushing is to minimise the risk of pipework deterioration and/or water quality problems. The system should be flushed at least weekly, but preferably at a frequency of at least twice per week, by opening all outlets for a period that is long enough to completely recharge the system with fresh water. This practice should continue until such time as the system is brought into regular use. Under certain circumstances, consideration should also be given to frost protection.

Reference to the need to avoid stagnation in pipework is made in various publications including HSE publication L8⁽¹⁾ (particularly paragraphs 164-189) which provide information on how to prevent the development of legionella bacteria in water systems, and regular monitoring to ensure continued effectiveness.

Certain systems will require disinfection prior to bringing into use, to comply with the requirements of BS EN 806-4⁽²⁾. For further information on disinfection, see Section 3.3 of this manual.

3.3 Disinfection

After flushing, disinfection may also be required. This is not a task for the inexperienced and should always be carried out by someone with the appropriate skill and training. It is important to gain an understanding of when and how disinfection should be carried out. The correct procedure is laid down in BS EN 806-4⁽²⁾

Systems should be disinfected in the following situations:

- a) in new installations (except private dwellings occupied by a single family);*
- b) where major extensions or alterations have been carried out;*
- c) where underground pipework has been installed (except where localised repairs only have been carried out or junctions have been inserted);*
- d) where it is suspected that contamination may have occurred, e.g. fouling by sewage, drainage, animals or physical entry by site personnel for interior inspection, painting or repairs;*
- e) where a system has not been in regular use and not regularly flushed.*

Section 6.3.3 of BS EN 806-4⁽²⁾ states that *“The system shall be filled with the disinfectant solution at the initial concentration and for the contact time specified by the manufacturer of the disinfectant. If the residual of the disinfectant at the end of the contact time is less than the manufacturer's recommendation, the disinfection procedure shall be repeated as necessary until the residual concentration is achieved after the appropriate contact time. After successful disinfection, the system shall be immediately drained and thoroughly flushed with drinking water. Flushing shall continue in accordance with the disinfectant manufacturers' instructions/recommendations or until there is no evidence of the disinfectant being present.”*

In order to avoid problems developing, both in terms of preservation of water quality and prevention of corrosion, care needs to be exercised to ensure that the manufacturers' recommended strengths of disinfectant solutions and related dwell times are not exceeded during disinfection. It is equally important to ensure that, after disinfection, systems are thoroughly flushed with fresh water.

3.4 Cold Bending

Half-hard copper tubing to BS EN 1057⁽⁵⁾ R250 in straight lengths is in an ideal condition for cold bending, using either a bending spring or a machine as appropriate. Nevertheless, to achieve consistently satisfactory bends some basic precautions must be observed:

3.4.1 Spring Bending

During internal spring bending, the use of a little lubricating oil or grease greatly assists the bending operation and prolongs the life of the spring by preventing rusting.

As with any equipment, bending springs must be kept in good condition and when worn they should be replaced. Internal bending springs are normally used for half-hard, 12, 15 and 22mm tubing, although clearly the choice of spring depends on the wall thickness of the tube being manipulated. For example, the nominal internal diameter of 15mm Yorkex tubing is 13.6mm, whereas that of 15mm Kuterlon material is only 13mm. It is essential to use the appropriate size of spring that fits snugly into the tube. Bends can usually be made by hand, bending gradually but firmly around the knee, to a minimum radius of around 5 times the diameter of the tubing in question.

Although some plumbers occasionally use an internal spring for larger tube sizes, it should be noted that this practice is not recommended or indeed allowed for in BS 5431⁽⁴⁾ (the British Standard for bending springs). Hence consistently satisfactory spring bending of tubes in sizes above 22mm cannot be guaranteed.

External bending springs are also available for half-hard tube in sizes up to and including 10mm.

3.4.2 Machine Bending

Bending machines form significantly tighter bends (minimum root/inside radius approximately 3 x o.d. of tube) than are possible using a spring. This method is by far the most widely used for bending copper tubes in the U.K. Machines are supplied by various manufacturers in many forms but essentially fall into one of two categories, i.e. "non-adjustable" or "adjustable".

3.4.2.1 Non-adjustable Machine Bending

Non-adjustable bending machines are commonly used for bending smaller size tubes (i.e. up to and including 22mm o.d.). These benders offer two main advantages over adjustable machines in that they are relatively inexpensive and usually light in weight, hence more portable.

When choosing a non-adjustable bender care should be taken to ensure that the machine is suitable for bending the specification of the tube being used.

As with any tooling, care should always be taken with maintenance, with particular regard to the replacement of worn guides or formers (preferably with a matched pair).

3.4.2.2 Adjustable Machine Bending

Adjustable bending machines are readily available in sizes up to and including 28mm. Occasionally, they may be employed to manipulate half-hard tubing in sizes up to and including 54mm. They have the advantage of allowing the operator to adjust the pressure applied to the tube, via the guide, thereby compensating for any slight tooling wear or even marginal differences in physical and mechanical properties between different batches of tube, albeit within the confines of the specification.

The point at which bending pressure is exerted on the tube is crucial and must be maintained at a fixed distance in front of the point of support of the former. If this distance is too small, excessive "necking" (or throating) at either end of the bend will occur; too great and corrugations or "wrinkles" may result along the inside radius.

Clearly, manipulation of medical quality tubing must be undertaken using equipment applied to the outside of the tube only, since internal springs will compromise the cleanliness of the bore.

N.B. It should be noted that bending has no detrimental effect on maximum safe working pressures of half-hard tubes, since any slight reduction in wall thickness along the outer radii of bends is off-set by the increase in hardness of the tube in the manipulated region.

3.4.3 Bending Options for Plain Tubes

Product	Outside diameter (mm)	External spring	Internal spring	Bending machine
Minibore (soft coils)	6	✓		✓
	8	✓		✓
	10	✓		✓
Kuterlon (soft coils)	15			✓
	22			✓
6-54mm Yorkex & 6-28mm Kuterlon (half-hard straight lengths) including chrome plated Yorkex	6	✓		✓
	8	✓		✓
	10	✓		✓
	12		✓	✓
	15		✓	✓
	22		✓	✓
	28			✓
	35			✓
	42			✓
	54			✓

NOTES

- ◆ When bending chrome plated tube, care must be taken to ensure that the plating is not scratched or abraded by the tooling. This can usually be achieved by wrapping the tube with a thin, soft cloth prior to manipulation.
- ◆ Yorkex tubing in sizes 35, 42 and 54mm is also supplied in the fully hard condition. Such tubes are not suitable for bending under any circumstances.
- ◆ All Yorkex tubes in sizes above 54mm and all Kuterlon tubes in sizes above 28mm are unsuitable for bending.

3.4.4 Bending Options for Plastic Covered Tubes

Product	Outside diameter (mm)	Internal spring	* Bending machine	
		Kuterlex & Kuterlex plus	Kuterlex	Kuterlex Plus
Soft Coils	8		✓	✓
	10		✓	✓
	15		✓	✓
	22		✓	✓◆
Half-hard, straight lengths	15	✓	✓	✓
	22	✓	✓	✓◆
	28		✓	✓◆

* Using appropriately sized formers and guides.

NOTES

- ◆ If machine bending of Kuterlex Plus tubing in sizes above 15mm is required, the following procedure is recommended :-
 1. Carefully remove the plastic cover along the portion of tube to be bent.
 2. Bend the plain copper tube using a machine fitted with appropriately sized tooling.
 3. Re-instate the covering and make good by spirally wrapping the re-instated section, together with 50mm long portions of the adjacent (i.e. intact) covering, either side of the exposed region, with a suitable waterproof, adhesive plastics tape. If re-instatement of the covering following bending is difficult or impractical, the entire, exposed section of copper tube should be protected using an appropriate waterproof tape.

3.5 Use with Fittings

Tube joints can be made by a variety of fittings such as:

- ◆ integral solder ring (ISR) capillary
- ◆ end-feed capillary
- ◆ braze end-feed
- ◆ non-manipulative compression (Type A)
- ◆ manipulative compression (Type B)
- ◆ push fit
- ◆ crimp or press fit

Fittings that meet the requirements of BS EN 1254 ⁽⁶⁻¹⁰⁾ and BS 8537 ⁽¹¹⁾ are compatible with copper tube to BS EN 1057 ⁽⁵⁾.


**NOT ALL FITTINGS ARE SUITABLE FOR ALL APPLICATIONS,
ADVICE SHOULD BE SOUGHT FROM THE FITTINGS MANUFACTURER**

FITTINGS MUST BE USED IN ACCORDANCE WITH THE MANUFACTURERS' INSTRUCTIONS

3.5.1 Soft Soldered Joints

It has been shown that lead in solders can make a small contribution towards lead pick-up in soft waters. This prompted the introduction of integral solder ring (ISR) fittings in which no lead is used, the solders commonly being tin-silver or copper-tin. These are suitable for drinking (potable) water supplies.

ISR and end-feed joints utilise a solder alloy of relatively low melting point (usually copper/tin or silver/tin). The solder is drawn into a narrow gap between the tube and the fitting. When solidified this produces a joint which is even stronger than the tube. In a properly designed, installed and maintained installation, a suitably made joint will, like the tubing, last the lifetime of the building. To ensure that the solder runs easily into the capillary gap a flux must be used to remove any oxide films from the tube and fitting. Clearly the flux is aggressive to copper but when used correctly and sparingly it is consumed in the jointing process and causes no problems.

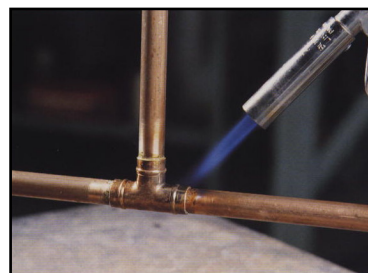

3.5.2 Soft Soldering Plastics Covered Copper Tube

See section 3.1.5 of this manual.

3.5.3 Hard Soldered (Brazed) Joints

Braze jointing (also known as hard soldering) again utilises the capillary gap between tube and fitting. This time the filler material (brazing rod) is one with a higher melting point (such as a copper/phosphorous alloy) and often does not require a flux. This type of joint is often used in conjunction with degreased tubing for medical gas applications and oxygen lines, where the use of grease-based fluxes is prohibited. It is also commonly employed on larger diameter tubes and in many engineering applications.


Systems for high temperature and/or pressure applications (e.g. steam services) commonly incorporate brazed, or high temperature solder, fittings. These utilise fluxes based on borates or fluoroborates.

It should be noted that when brazing hard or half-hard copper tubing, the temperatures involved convert the metal in the heat-affected zone around the joint to the soft condition. This has the effect of reducing the as-supplied, maximum safe working pressures (see section 4.4).

3.5.4 Compression Joints

These joints use the tightening action of nuts on threads in the fittings to produce a watertight joint on the tube, either by tightening up on an olive (non-manipulative or “Type A” fittings) or by tightening up on a pre-shaped end of the tube (manipulative or “Type B” fittings).

3.5.5 Push Fit Joints

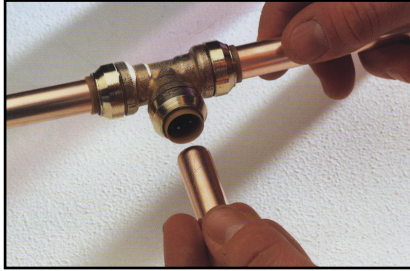

Push Fit fittings are available where the tube is simply pushed into the fitting to develop a sound joint. The seal is made by an 'O' ring and the tube held in place by a grab ring. Some fittings are designed to be re-usable and can be released using a special tool, thereby enabling easy change of system components. Push-fit joints are completely heat-free. Special push-fit fittings are available to ensure electrical continuity.

3.5.6 Crimp or Press-Fit Joints

These joints rely on a mechanical compression tool to seal an 'O' ring between the copper tube and fitting without the need for solder, adhesives, or additional jointing materials. Joints are made by compressing part of the crimp fitting using the press-fit tool. The jointing system is completely heat-free.



3.5.7 Using Fittings with Chrome Plated Tubes

Special precautions must be taken when using fittings with chrome plated tube. Please see section 5.3.2 of this manual.

3.6 Use of Fluxes

Capillary joints have become a traditional and reliable part of installation practice to such an extent that they can usually be expected to last the entire lifetime of the systems on which they are installed.

In order to achieve such longevity, skilled installers have learnt that certain basic precautions need to be taken during assembly operations, including careful and sparing use of flux. Indeed when making capillary joints, care should be taken to prevent excess quantities of flux from running into the tube since fluxes are, of necessity, aggressive to the metals for which they are used, their purpose being to chemically clean the mating surfaces in order to effect sound bonding. Any small excess is normally destroyed by heat during the soldering operation or swept away by the initial ingress of water. However, excessive amounts may cause continued corrosion, until the active ingredients are used up or perforation of the tube or fitting occurs.

Whilst fluxes are to some extent soluble in water, the solubility factor is dependent upon the amount of flux present. Thus, if a relatively small amount of flux remains following installation, the flux will be dissolved fairly quickly. However, if excessive amounts remain it may take months for the flux to dissolve. Indeed in some cases the flux may form a hard, water repellent “skin” or become coated with deposits which protect it from dissolution. It should also be borne in mind that problems due to the inappropriate use of flux can occur on both hot or cold water systems, though they generally tend to happen less frequently on hot circuits where elevated temperatures increase their solubility.

All fluxes should be used sparingly and strictly in accordance with manufacturer’s instructions. The use of excessive flux must be avoided. Some fluxes are more aggressive than others but all fluxes should be considered to be corrosive to some extent. Any excess flux should be wiped off the assembly before applying heat to melt the solder and any residue removed immediately the joint has cooled. The system should be cleared of any internal residues.

3.7 Burying Tubes in Contaminated Ground

When copper pipework is to be laid directly in contaminated ground, it should be borne in mind that such environments can contain various substances which are potentially aggressive to copper. Such substances include sulphides, ammonia or ammonia-based compounds, mercury or mercurous compounds, nitrates, sulphates, chlorides, particles of carbonaceous matter, acidic compounds, decomposing vegetation, etc.

BS EN 806-4⁽²⁾ states, in Section 4.6, that; *“Where ground contamination is encountered or suspected, suitable impermeable pipework shall be used or the pipe shall be sleeved. No pipe susceptible to deterioration by contact with any substance shall be laid or installed in a place where such deterioration is likely to occur.”*

“Kuterlon” tubing to BS EN1057⁽⁵⁾ in R250 or R290 (straight lengths) or R220 (coiled) format, is recommended when pipework is to be laid directly in the ground, since it has a greater wall thickness than “Yorkex” tubing of a similar diameter. It is therefore more able to withstand external loads, vibrations, traffic movement etc.

In consideration of the above, we would recommend the use of our “Kuterlex” plastics covered copper tube, to the dimensional specification of our “Kuterlon” range, for use in situations where the surrounding environment may be contaminated or potentially aggressive to the bare metal. The copper element of the product is eminently suitable for below ground applications and provides a barrier to any permeation of contaminants, whilst the plastics coating protects the tube from any materials that in the surroundings that may be aggressive to the copper.

Any joints along such tube runs should also be protected by spirally wrapping with a suitable waterproof, adhesive plastics tape in such a manner that moisture cannot gain ingress between the laps in the tape. Taping should cover any bare sections of copper pipework together with a 50mm (approx) long portion of the adjacent plastic covering either side of the exposed copper (see section 3.1.5).

3.8 Lagging of Pipework

A number of different insulation materials exist which are eminently suitable for use in conjunction with copper tube. Each material possesses a thermal conductivity (λ) value which determines how well this particular material will perform in terms of reducing heat losses. The lower the value, the better the insulator. Below are some common types of lagging together with their respective approximate thermal conductivities:

MATERIAL	λ (W/mK)
Nitrile/Elastomeric Rubber	0.035
Polyethylene Foam	0.034/0.035
Mineral Wool	0.032
Polyurethane (PUR)	0.025
Polyisocyanurate (PIR)	0.023
Phenolic Foam	0.018

Choosing which particular type of lagging to use and how thick that lagging has to be depends on how much thermal insulation is required. BS5422⁽¹³⁾ gives reference to the thicknesses required for materials with different thermal conductivities in order to achieve particular heat losses on both hot water and central heating systems (see table below) :

Environmental insulation thickness for domestic central heating installations and hot water systems in potentially unheated areas to control heat loss

OD of Cu Tube (mm)	Insulation Thickness (mm)					Heat Loss (W/m)	
	$\lambda=0.025$	$\lambda=0.030$	$\lambda=0.035$	$\lambda=0.040$	$\lambda=0.045$	Hot Water (60°C)	Central Heating (75°C)
10	10	16	22	31	44	6.8	8.6
12	12	18	26	36	49	7.3	9.2
15	15	22	31	42	58	7.8	9.7
22	19	26	35	47	62	8.2	10.2
28	21	28	38	49	64	9.0	11.3
35	22	30	39	51	64	10.0	12.6
42	23	31	41	52	65	11.0	13.8
54	25	33	42	53	65	12.8	16.0
From Table 14 of BS 5422							

For example, a nitrile rubber lagging with a wall thickness of 31mm, when used in conjunction with a 15mm OD copper tube, will give a heat loss of 7.8W/m on a hot water system and 9.7W/m on a central heating system.

It is strongly recommended that rigid phenolic foam insulation materials are installed so that moisture cannot gain ingress to the tube/lagging interface, otherwise external corrosion of the copper pipework may occur.

All insulation products should always be installed in accordance with the manufacturer's installation instructions.

3.9 Medical Gas Tube

Yorkshire Copper Tube supplies specially cleaned tubes meeting the cleanliness requirements of BS EN 13348⁽²¹⁾ for medical quality and oxygen pipeline systems (see section 5.4 of this Guide).

These tubes are supplied with ends individually plugged to prevent internal contamination. Plugs must be retained in the tubes during storage. It is also important that the ends of these tubes are kept closed and ends re-sealed if part lengths are used. Tubes must always be cut with a pipe-cutter (not a hacksaw) to prevent ingress of any particulate matter (e.g. copper swarf).

Additionally tubes in the 12-54mm diameter range are manufactured in full accordance with BS EN 13448⁽²¹⁾. Tubes in this size range are also 'Kitemarked' as independent confirmation by BSI that tubes conform to the specification.

Jointing and installation practices for this type of tube differ from standard plumbing tubes and are defined in HTM 02-01⁽²⁰⁾. These practices must always be followed for all medical installations to prevent contamination of the gas line and on oxygen lines to prevent the risk of explosion.

This page has been intentionally left blank

Section 4 – Technical Data

4.1 Pipe Sizing, Flow Rates and Pressure Drops

Nomograms for determining pipe size from flow rate, velocity and pressure loss are shown on the next page.

Water velocities in a system should be between 0.5 m/s (below which any suspended matter may settle out) and 2 m/s (above which erosion corrosion damage may occur). If the tube size originally chosen gives rise to velocities outside these parameters, a smaller or larger tube size respectively should be adopted.

The resistance to flow of fittings and taps should also be taken into account. The simplest way to do this is to regard each fitting as an equivalent length of the appropriate size of tubing as indicated in the tables below.

For further detailed information regarding equivalent lengths refer to CDA Publication 33⁽¹²⁾.

Equivalent copper tube lengths for fittings / valves				
Tube Diameter (mm)	Nominal equivalent tube length (m)			
	Elbow	Tee	Stopvalve	Checkvalve
15	0.5	0.6	4.0	2.5
22	0.8	1.0	7.0	4.3
28	1.0	1.5	10.0	5.6
35	1.4	2.0	13.0	6.0
42	1.7	2.5	16.0	7.9
54	2.3	3.5	22.0	11.5
66.7	3.0	4.5	-	-
76.1	3.4	5.8	34.0	-
Note: Losses through tees can be taken to occur on a change of direction only. Losses through fully open gatevalves can be ignored. Where systems have special fittings with significant head losses, reference should be made to the manufacturer.				

Typical Loss of Head Through Taps (and equivalent tube lengths)			
Tap	Flow rate (l/s)	Loss of head (m)	Equivalent tube length (m)
Nominal 1/2"	0.20	0.8	3.7
Nominal 3/4"	0.30	0.8	11.8
Nominal 1"	0.60	1.5	22.0
Note: Losses for stated flow rates are typical only and may vary with taps of different manufacturers.			



Example Calculation

For a run of 10m of 15mm tubing with 4 capillary elbows, in a cold water service feeding a 3/4" bath tap, with an available head of 4m requiring a flow rate of **0.3 l/s** the calculation is as follows:

Equivalent tube length $10 + (4 \times 0.5) + 11.8 \text{ m} = 23.8\text{m}$ (say 24m)

Permissible head loss = available head/equivalent tube length = $4 / 24 = \mathbf{0.15 \text{ m/m}}$.

By reference to the appropriate nomogram (see page 4-2), draw a line from 0.15 m/m head loss extending through 0.3 l/s flow rate, as indicated by the solid line on the cold water service nomogram. The intercept on the right hand copper tube diameter axis indicates that 22mm tube (the next size up) would be satisfactory. The broken line drawn from the chosen 22mm diameter through the required 0.3 l/s flow rate shows the actual head loss consumed when using this size of tube.

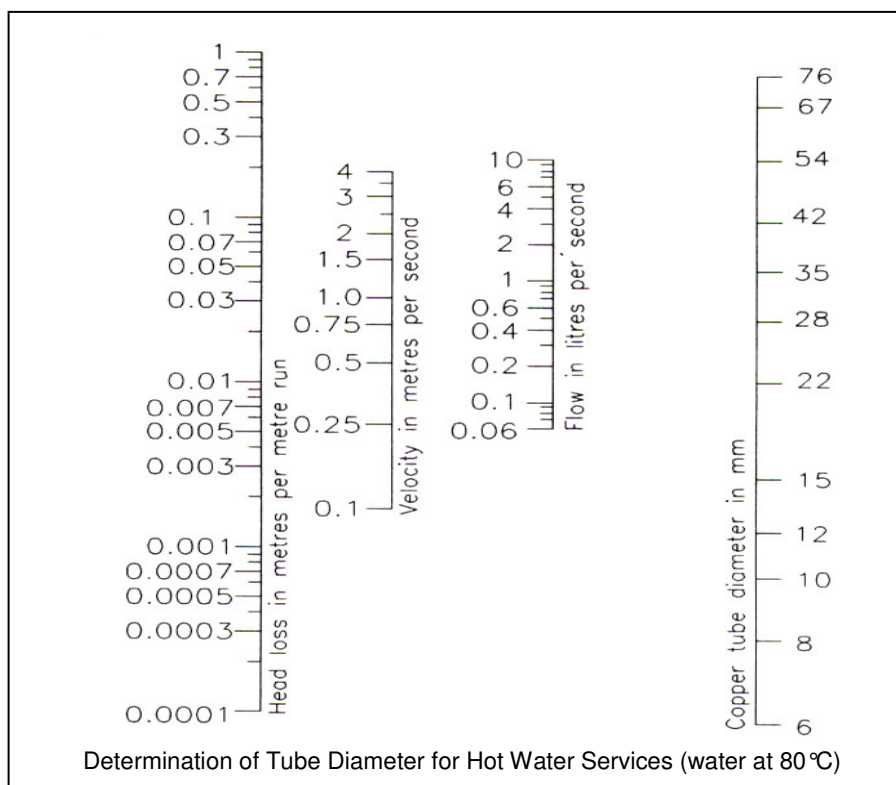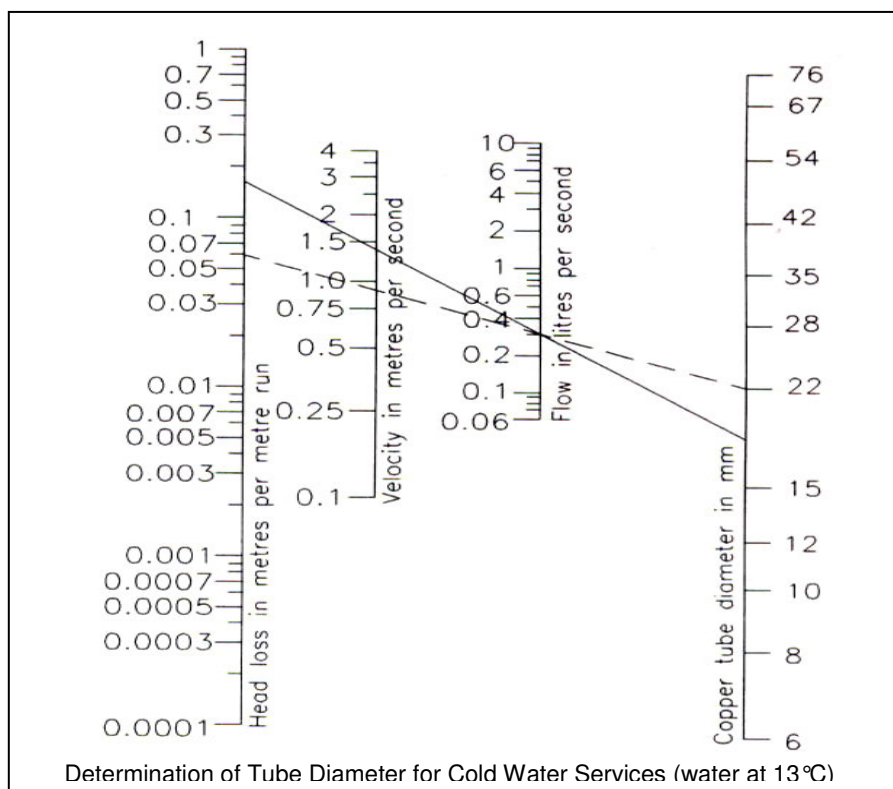

4.2 Tube Support Distances

To secure tubes and prevent sagging and distortion, tubes should be supported at the following maximum distances.

Tube Diameter (mm)	Intervals for Vertical Run (m)	Intervals for Horizontal Run (m)
6	0.6	0.4
8	0.9	0.6
10	1.2	0.8
12	1.5	1.0
15	1.8	1.2
22	2.4	1.8
28	2.4	1.8
35	3.0	2.4
42	3.0	2.4
54	3.0	2.7
66.7	3.6	3.0
76.1	3.6	3.0
108	3.6	3.0
133	3.6	3.0
159	4.2	3.6

4.3 Thermal Expansion And Contraction

The coefficient of linear expansion of copper is 16.8×10^{-6} per °C.

The table below shows the increase in length (in mm) due to thermal expansion, as a function of change in temperature Δt , and the length of the tube at the lower temperature. All figures are irrespective of temper condition (hardness) or wall thickness.

Expansion (mm) of copper tube as a function of tube length and temperature difference								
Tube Length (m)	Temperature difference Δt (°C)							
	30	40	50	60	70	80	90	100
0.1	0.05	0.07	0.08	0.10	0.12	0.13	0.15	0.17
0.2	0.10	0.13	0.17	0.20	0.24	0.27	0.30	0.34
0.3	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50
0.4	0.20	0.27	0.34	0.40	0.47	0.54	0.60	0.67
0.5	0.25	0.34	0.42	0.50	0.59	0.67	0.76	0.84
0.6	0.30	0.40	0.50	0.60	0.71	0.81	0.91	1.01
0.7	0.35	0.47	0.59	0.71	0.82	0.94	1.06	1.18
0.8	0.40	0.54	0.67	0.81	0.94	1.08	1.21	1.34
0.9	0.45	0.60	0.76	0.91	1.06	1.21	1.36	1.51
1.0	0.50	0.67	0.84	1.01	1.18	1.34	1.51	1.68
2.0	1.01	1.34	1.68	2.02	2.35	2.69	3.02	3.36
3.0	1.51	2.02	2.52	3.02	3.53	4.03	4.54	5.04
4.0	2.02	2.69	3.36	4.03	4.70	5.38	6.05	6.72
5.0	2.52	3.36	4.20	5.04	5.88	6.72	7.56	8.40
10.0	5.04	6.72	8.40	10.08	11.76	13.44	15.12	16.80
15.0	7.56	10.08	12.60	15.12	17.64	20.16	22.68	25.20
20.0	10.08	13.44	16.80	20.16	23.52	26.88	30.24	33.60
25.0	12.60	16.80	21.00	25.20	29.40	33.60	37.80	42.00

Refer to section 3.1.2 for recommendations on accommodating thermal movement.

4.4 Pressure Ratings And The Effect Of Annealing

Maximum safe working pressures (MSWP) for tubes in the as-supplied hardness condition at different temperatures are shown in bold type in the table below.

If tubes are brazed, (e.g. by oxy-acetylene torch) when using capillary fittings, they become softer in the heated region and annealed values should be used in design calculations Heating by propane torch during soft soldering does not significantly affect the safe working pressure.

Size		MSWP at 65°C		MSWP at 100°C		MSWP at 150°C		MSWP at 175°C		MSWP at 200°C	
Diameter (mm)	Thickness (mm)	supplied (bar)	annealed (bar)	supplied (bar)	annealed (bar)	supplied (bar)	annealed (bar)	supplied (bar)	annealed (bar)	supplied (bar)	annealed (bar)
YorkeX - Half hard		133	102	116	89	Not Recommended					
6	0.6	97	75	85	65						
8	0.6	77	59	67	51						
10	0.6	63	48	55	42						
12	0.6	58	45	51	39						
15	0.7	51	39	45	34						
22	0.9	40	31	35	27						
28	0.9	42	33	37	28						
35	1.2	35	27	31	24						
42	1.2	27	21	24	18						
YorkeX - Hard		42	27	37	24	Not Recommended					
35	1.0	51	33	45	28						
35	1.2	35	22	31	20						
42	1.0	42	27	37	24						
42	1.2	33	21	29	18						
54	1.2	26	17	23	15						
66.7	1.2	29	18	25	16						
76.1	1.5	20	13	18	11						
108	1.5	17	10	14	9						
133	1.5	18	12	16	10						
159	2.0										
Kuterlon		188	144	161	123	136	105	104	80	72	55
6	0.8	136	105	116	89	99	76	75	58	52	40
8	0.8	106	82	91	70	77	59	59	45	41	31
10	0.8	87	67	75	57	63	49	48	37	34	26
12	0.8	87	67	75	57	63	49	48	37	34	26
15	1.0	69	57	60	46	51	39	39	30	27	21
22	1.2	54	42	47	36	40	30	30	23	21	16
28	1.2	65	41	56	36	48	30	37	23	25	16
35	1.5	54	34	47	30	40	25	30	19	21	13
42	1.5	56	36	48	31	41	26	32	20	22	14
54	2.0	45	28	39	25	33	21	25	16	18	11
66.7	2.0	39	25	34	22	29	18	22	14	15	10
76.1	2.0	34	22	30	19	25	16	19	12	13	9
108	2.5										
Minibore		102	102	89	89	Not Recommended					
6	0.6	75	75	65	65						
8	0.6	69	69	60	60						
10	0.7										

Kuterlon coils are supplied in the annealed condition so the quoted annealed value should be used

The above figures are calculated using stress values quoted in BS1306⁽²²⁾.

Note : Only Kuterlon pipework is recommended for temperatures above 100°C.

4.5 Suitability Of Copper With Various Materials

Acetic (Acid)	B	Chromic Acid	D	Oxalic Acid	C
Acetic (Anhydride)	B	Cider	A	Oxygen (tube must be grease free)	A
Acetone	A	Citric Acid	C	Oxygenated Water	B
Acetylene	D	Coffee	A	Palmitic Acid	B
Alcohols	A	Copper Chloride	C	Paraffin Wax	A
Alum	B	Copper Nitrate	C	Phosphoric Acid	C
Alumina	A	Copper Sulphate	B	Potash	B
Aluminium Chloride	B	Corn Oil	A	Potassium Carbonate	B
Aluminium Hydroxide	A	Cottonseed Oil	A	Potassium Chloride	B
Aluminium Sulphate	B	Creosote	A	Potassium Chromate	B
Ammonia Gas (dry)	A	Crude Oil (low sulphur)	A	Potassium Cyanide	D
Ammonia Gas (wet)	D	Drinking Water	A	Potassium Sulphate	A
Ammonium Hydroxide	D	Ethers	A	Propane	A
Ammonium Chloride	D	Ethyl Acetate	A	Rosin	A
Ammonium Nitrate	D	Ethyl Chloride	B	Seawater	C
Ammonium Sulphate	D	Ethylene Glycol (inhibited)	A	Silver Salts	D
Amyl Acetate	A	Ethyl Alcohol	A	Soaps (solutions of)	B
Amyl Alcohol	A	Ferric Chloride	D	Sodium Bicarbonate	B
Aniline	D	Ferric Sulphate	D	Sodium Bisulphate	B
Aniline (dyes)	C	Ferrous Chloride	C	Sodium Bisulphite	B
Asphalt (dry)	A	Ferrous Sulphate	C	Sodium Carbonate	B
Atmosphere (Industrial)	A/B	Fluorosilicic Acid	C	Sodium Chloride	B
Atmosphere (Marine)	C	Formaldehyde	B	Sodium Chromate	B
Atmosphere (Rural)	A	Formic Acid	B	Sodium Cyanide	D
Barium Carbonate	A	Freon	A	Sodium Hypochlorite	C
Barium Chloride	B	Fruit Juice	B	Sodium Nitrate	B
Barium Hydroxide	A	Fuel Oil	A	Sodium Peroxide	C
Barium Sulphate	A	Furfural	B	Sodium Phosphate	B
Barium Sulphide	C	Gasoline	A	Sodium Silicate	A
Benzene	A	Gelatine	A	Sodium Sulphate	A
Benzine	A	Glucose	A	Sodium Sulphide	C
Benzoic Acid	D	Glue	B	Sodium Hyposulphite	D
Beer	A	Glycerine	A	Solvents for Varnish	A
Bordeaux Mixture	A	Hydrobromic Acid	D	Steam	A
Borax	A	Hydrocarbons (pure)	A	Stearic Acid	B
Boric Acid	A	Hydrochloric Acid	D	Sugarbeet (syrup)	A
Brine	C	Hydrocyanic Acid	D	Sulphur (dry)	B
Bromine (dry)	A	Hydrofluoric Acid	D	Sulphur (molten)	D
Bromine (wet)	C	Hydrogen	A	Sulphur Chloride (dry)	A
Butane	A	Hydrogen Sulphide (dry)	A	Sulphurous Anhydride (dry)	A
Butyl Alcohol	A	Hydrogen Sulphide (wet)	D	Sulphurous Anhydride (wet)	B
Butyric Acid	B	Kerosene	A	Sulphuric Anhydride (dry)	A
Calcium Chloride	C	Lacquers	A	Sulphuric Acid (80/95%)	D
Calcium Disulphide	B	Lactic Acid	B	Sulphuric Acid (40/80%)	D
Calcium Hydroxide	A	Lime	A	Sulphuric Acid (<40%)	C
Calcium Hypochlorite	C	Linseed Oil	B	Sulphurous Acid	C
Cane Sugar Syrup	A	Magnesia	A	Tannic Acid	B
Carbolic Acid	C	Magnesium Chloride	B	Tar (dry)	A
Carbon Tetrachloride (dry)	A	Magnesium Sulphate	A	Tartaric Acid	C
Carbon Tetrachloride (wet)	B	Mercury (and its salts)	D	Toluene	A
Carbon Dioxide (dry gas)	A	Methyl Chloride (dry)	A	Trichloroacetic Acid	C
Carbon Dioxide (wet gas)	D	Methyl Alcohol	A	Trichloroethylene (dry)	A
Castor Oil	A	Milk	A	Trichloroethylene (wet)	B
Caustic Soda	B	Mine Water (acid)	C	Turpentine	A
Chlorine (dry)	A	Natural Gas	A	Varnish	A
Chlorine (wet)	D	Nitric Acid	D	Vinegar	C
Chloroacetic Acid	C	Nitrogen	A	Zinc Chloride	C
Chloroform	A	Oleic Acid	C	Zinc Sulphate	C

A : Resistant to corrosion

B: Resists corrosion well

C: Undergoes slow corrosion

D: Copper not recommended

Section 5 – Product Specifications

5.1 Copper Tubes

6-108mm tubes are Kitemarked. All meet requirements of BS EN 1057 ⁽⁵⁾ which defines the following:

5.1.1 Material Analysis

Material Grade	Phosphorus de-oxygenised copper; Cu-DHP or CW024A as defined in BS EN 1976 ⁽¹⁴⁾ .
Minimum Copper Content	99.90 % (including silver)
Phosphorus	0.015-0.040 %
Total Impurity Maxima	0.060 % (excluding phosphorus and silver)

5.1.2 Mechanical Properties








Material Temper		Tensile Strength	Elongation	Hardness
Designation see BS EN 1173 ⁽¹⁵⁾	Common Term	min. (N/mm ²)	min. (%)	(indicative) (Hv ₅)
R220	annealed / soft	220	40	40 – 70
R250	half hard	250	30 - Yorkex 20 - Kuterlon	75 – 100
R290	Hard	290	3	Over 100

5.1.3 Dimensions and Tolerances

Nominal Outside Diameter	Thickness Tolerance		Diameter Tolerance	
	up to 1mm	1mm and over	mean	Including ovality
6 - 15mm	± 10%	± 13%	± 0.04mm	± 0.09mm
22 - 28mm	± 10%	± 15%	± 0.05mm	± 0.10mm
35 - 54mm		± 10 % (1.2mm R250) ± 15 % (other products)	± 0.06mm	± 0.07mm (R290) ± 0.11mm (R250)
66.7 - 76.1mm		± 15 %	± 0.07mm	± 0.10mm
108mm		± 15 %	± 0.07mm	± 0.20mm
133 - 159mm		± 15 %	± 0.2mm	± 0.7mm

Note : Ovality tolerance not applicable to R220 (annealed) tubes

5.1.4 Marking

Yorkex half hard	YORKSHIRE EN 1057 U.K. size  YORKEX  date
Yorkex hard	YORKSHIRE EN 1057 U.K. size  YORKEX date
Kuterlon half hard	YORKSHIRE EN 1057 U.K. size   date
Kuterlon hard	YORKSHIRE EN 1057 U.K. size  date
Minibore / Kuterlon coils	YORKSHIRE size date EN 1057 

Note : Size is diameter x thickness.
Date is month and year, or quarter and year.
Additional factory production line identification may be included.
Sequence of markings may alter depending on production line

5.2 Plastic Covered Tubes

All plastic covered tubes comprise copper tubes to BS EN 1057⁽⁵⁾ covered with plastic to meet the combined requirements of BS EN 13349⁽¹⁶⁾.

5.2.1 Plastic Material Analysis

YorkeX & Kuterlon Products LDPE (Low Density Polyethylene)
Minibore Products PVC (Polyvinylchloride)

5.2.2 Colour Identification



Product colour coding is in accordance with BS 1710⁽¹⁷⁾ for Yellow Ochre and Green covered tubes.

Pipe Contents	Colour	BS 4800 ⁽¹⁸⁾ Colour Reference
Gases (except air)	Yellow Ochre	08 C 35
Water	Green	12 D 45
	Blue	18 E 51

5.2.3 Plastic Covering Thickness and Tolerances

Kuterlex			Kuterlex Plus		
<i>Nominal Outside Diameter</i> (mm)	<i>Nominal Thickness</i> (mm)	<i>Thickness Tolerance</i> (mm)	<i>Nominal Outside Diameter</i> (mm)	<i>Nominal Thickness</i> (mm)	<i>Thickness Tolerance</i> (mm)
6 - 28mm	1.0	± 0.1	8 - 10mm	1.6	± 0.3
35 - 54mm	1.5	± 0.15	12 - 22mm	2.0	± 0.3
66.7 - 76.1mm	2.0	± 0.2	28 - 35mm	2.5	± 0.4
			42 - 54mm	3.0	± 0.5

5.2.4 Ink Printing (applied to the plastics covering)

<u>Straight Lengths</u>	
YorkeX Kuterlex	YORKSHIRE UK YORKEX KUTERLEX size EN 1057 EN 13349 date
YorkeX Kuterlex Plus	YORKSHIRE UK YORKEX KUTERLEX PLUS size EN 1057 EN 13349 date
Kuterlon Kuterlex	YORKSHIRE UK KUTERLON KUTERLEX size EN 1057 EN 13349 date
<u>Coils</u>	
Kuterlon Kuterlex	YORKSHIRE KUTERLON KUTERLEX Copper Tube to EN 1057 – R220 size  date EN 13349
Kuterlon Kuterlex Plus	YORKSHIRE KUTERLON KUTERLEX PLUS Copper Tube to EN 1057 – R220 size  date EN 13349
Minibore Kuterlex	YORKSHIRE MINIBORE KUTERLEX size EN 1057 EN 13349 date
Minibore Kuterlex plus	YORKSHIRE MINIBORE KUTERLEX PLUS size EN 1057 EN13349 date
Note : Size is diameter x thickness. Date is included in a production code reference. An additional “UK” is marked after “YORKSHIRE” for 5.8m lengths. An additional “HH” is marked after “EN 1057” for 15-28mm R250 (half hard) condition straight lengths.	

5.3 Chrome Plated Tubes

Yorkex Chrome Plated tubes are half hard copper tubes, to BS EN 1057⁽⁵⁾ - R250, chrome plated in accordance with BS EN ISO 1456⁽¹⁹⁾, generally to Service Condition 2.

Chromium cannot be directly electrodeposited onto copper with satisfactory adhesion, therefore a layer of nickel is deposited before the finishing layer of chromium is applied.

Nominal thickness' of the respective layers are as follows:

Nickel	:	10 µm
Chromium	:	0.3 µm

5.3.1 Bending Chrome Plated Tubes

Chrome plated tubes are suitable for cold bending in the 'as supplied' condition using appropriately sized bending machines or springs (see Section 3.4). When using a bending machine, care should be taken not to damage the chromium plated surface by ensuring that the equipment used is in good condition and a lubricant is used to ease forming.

5.3.2 Jointing Chrome Plated Tubes

5.3.2.1 Capillary Jointing


It is essential to remove the chrome plating in order to solder capillary fittings. This is best done by using a fine-toothed flat file, carefully removing the chrome until bare copper is visible all the way round the tube for the full insertion depth of the fitting. Care must be taken not to remove too much metal; otherwise the capillary gap may become too big for a leak tight joint to be made. Once the plating has been removed, the remainder of the jointing process is the same as normal, except that a damp rag should be wrapped around the tubes close to the fitting to prevent damage from the blowtorch flame.

5.3.2.2 Compression Jointing

When making compression joints with chrome plated tubes, the harder nature of the chrome plating makes it necessary to increase the torque applied to the compression nut to ensure a sound joint.

5.3.2.3 Push Fittings

It is sometimes necessary to use a special scribing tool to create a scored mark round the tube to enable the grab ring to grip effectively.

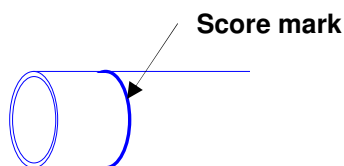

5.3.2.4 Press Fittings

Press fittings should not be used with chrome plated tube, as the distortion made when forming the joint will cause the chrome plating to crack.





5.4 Medical Gas Tubes

Yorkshire Medical Gas tubes, available in both the Yorkex and Kuterlon ranges, are specially cleaned tubes suitable for use with Medical Gases and oxygen. Tubes are supplied with ends individually plugged to prevent bore contamination.

The special cleaning is important to eliminate explosion risk in oxygen pipelines and contamination of respirable gases.

Tubes are cleaned to meet the cleanliness requirements as specified in BS EN 13348⁽²¹⁾ and thereby meet the specification for pipeline materials as defined in HTM 02-01⁽²⁰⁾.

Tubes in the 12-54mm diameter range are engraved as follows:

Yorkex Medical half hard	YORKSHIRE EN 13348 U.K. size  DEG HH date
Yorkex Medical hard	YORKSHIRE EN 13348 U.K. size  DEG date
Kuterlon Medical half hard	YORKSHIRE EN 13348 U.K. size  DEG HH date
Kuterlon Medical hard	YORKSHIRE EN 13348 U.K. size  DEG date
Note : Size is diameter x thickness. Date is month and year, or quarter and year. Additional factory production line identification may be included. Sequence of markings may alter depending on production line	
Engravings may also include the brand name 'Yorkex Medical' or 'Kuterlon Medical'	

Other sizes are marked with an additional “DEG” on standard engravings (see section 5.1.4), to denote compliance.

Section 6 – Approvals

6.1 Quality System



Certificate of Registration

QUALITY MANAGEMENT SYSTEM - ISO 9001:2008

This is to certify that:

KME Yorkshire Ltd
East Lancashire Road
Kirkby
Liverpool
L33 7TU
United Kingdom

Holds Certificate No: FM 00450
and operates a Quality Management System which complies with the requirements of ISO 9001:2008 for the following scope:

The manufacture of 6mm to 108mm solid drawn copper tubes for water, gas, sanitation and general purposes to national, international, customer and own specifications/requirements. Tubes can be supplied electroplated with nickel plus chromium topcoat or in pre-insulated form with external plastic covering.

The manufacture and/or supply of copper and copper alloy products, including tubes, bars and rolled products.

For and on behalf of BSI:



Gary Fenton, Global Assurance Director

Originally registered: 13/12/1990 Latest Issue: 16/01/2012 Expiry Date: 10/09/2014



Page: 1 of 2

This certificate was issued electronically and remains the property of BSI and is bound by the conditions of contract. An electronic certificate can be authenticated [online](#). Printed copies can be validated at [www.bsigroup.com/ClientDirectory](#)

Information and Contact: BSI, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP. Tel: +44 845 080 9000
BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.
A Member of the BSI Group of Companies.



Certificate No: **FM 00450**

Location

Yorkshire Copper Tube
A Division of KME Yorkshire Ltd
East Lancashire Road
Kirkby
Liverpool
L33 7TU
United Kingdom

KME UK
A Division of KME Yorkshire Ltd
Severn House
Prescott Drive
Warndon Business Park
Worcester
WR4 9NE
United Kingdom

Registered Activities

The manufacture and supply of 6mm to 108mm solid drawn copper tubes for water, gas, sanitation and general purposes to national, international, customer and own specifications/requirements. Tubes can be supplied electroplated with nickel plus chromium topcoat or in pre-insulated form with external plastic covering.

The supply of copper and copper alloy products, including tubes, bars and rolled products.

Originally registered: 13/12/1990

Latest Issue: 16/01/2012

Expiry Date: 10/09/2014

Page: 2 of 2

This certificate was issued electronically and remains the property of BSI and is bound by the conditions of contract.
An electronic certificate can be authenticated [online](#).
Printed copies can be validated at www.bsigroup.com/ClientDirectory

Information and Contact: BSI, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP. Tel: +44 845 080 9000
BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.
A Member of the BSI Group of Companies.

bsi.

Kitemark™ Licence



This is to certify that:

Yorkshire Copper Tube
Division of KME Yorkshire Ltd
East Lancashire Road
Kirkby
Liverpool
L33 7TU
United Kingdom

Holds Kitemark Licence Number:

KM 05526

In respect of:
BS EN 1057

Copper and copper alloys. Seamless, round copper tubes for water and gas in sanitary and heating applications

This issues the right and Licence to use the Kitemark in accordance with the Kitemark Terms and Conditions governing the use of the Kitemark, as may be updated from time to time by BSI Assurance UK Ltd (the "Conditions"). All defined terms in this Licence shall have the same meaning as in the Conditions.

The use of the Kitemark is authorized in respect of the Product(s) detailed on this Licence provided at or from the above address.

For and on behalf of BSI:

Gary Fenton, Global Assurance Director

First Issued: 2/02/1972

Latest Issue: 8/02/2013



Page 1 of 3

...making excellence a habit.™

This Licence remains the property of The British Standards Institution and shall be returned immediately upon request.
To check its validity telephone +44 (0)845 080 9000

Information and contact: BSI, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP. Tel: +44 845 080 9000.
BSI Assurance UK Limited, registered in England under number 7805321, at 389 Chiswick High Road, London, W4 4AL, UK.
A member of the BSI Group of Companies.

No. KM 05526

BS EN 1057:2006 - Specification for copper and copper alloy tubes

Temper	OD (mm)	Wall Thickness (mm)
Soft (R220)	6	0.6, 0.8
	8	0.6, 0.8
	10	0.7, 0.8
	12	0.8
	15	1.0
	22	1.2
	28	1.2
Half-hard (R250)	6	0.6, 0.8
	8	0.6, 0.8
	10	0.6, 0.8
	12	0.6, 0.8
	15	0.7, 1.0
	22	0.9, 1.2
	28	0.9, 1.2
	35	1.2, 1.5
	42	1.2, 1.5
	54	1.2, 2.0
	66.7	1.2, 2.0
	76.1	1.5, 2.0
Hard (R290)	108	1.5, 2.5
	35	1.0, 1.2, 1.5
	42	1.0, 1.2, 1.5
	54	1.0, 1.2, 2.0
	66.7	1.2, 1.5, 2.0
	76.1	1.2, 1.5, 2.0
	108	1.5, 2.5

First Issued: 2/02/1972

Latest Issue: 8/02/2013

Page 2 of 3

This Licence remains the property of The British Standards Institution and shall be returned immediately upon request.
To check its validity telephone +44 (0)845 080 9000

Information and contact: BSI, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP. Tel: +44 845 080 9000.
BSI Assurance UK Limited, registered in England under number 7805321, at 389 Chiswick High Road, London, W4 4AL, UK.
A member of the BSI Group of Companies.

No. KM 05526

Tubes will be marked as follows:

Soft

YORKSHIRE EN 1057 U.K., OD x WALL, ♡, MONTH AND YEAR

Half-hard

YORKSHIRE EN 1057 U.K., OD x WALL, ♡, H, MONTH AND YEAR

Hard

YORKSHIRE EN 1057 U.K., OD x WALL, ♡, MONTH AND YEAR



First Issued: 2/02/1972

Latest Issue: 8/02/2013

Page 3 of 3

This Licence remains the property of The British Standards Institution and shall be returned immediately upon request.
To check its validity telephone +44 (0)845 080 9000

Information and contact: BSI, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP. Tel: +44 845 080 9000.
BSI Assurance UK Limited, registered in England under number 7805321, at 389 Chiswick High Road, London, W4 4AL, UK.
A member of the BSI Group of Companies.

Kitemark Licence



No. KM 70734

BSI hereby grants to:

**Yorkshire Copper Tube
Division of KME Yorkshire Ltd
East Lancashire Road
Kirkby
Merseyside
L33 7TU
United Kingdom**

In respect of:

BS EN 13348

Copper and copper alloys - Seamless, round copper tubes for medical gases or vacuum

the right and Licence to use the Kitemark in accordance with the Kitemark Licence Conditions of Contract governing the use of the Kitemark, as may be updated from time to time by BSI, and as approved by the Registrar under the Trade Marks Act 1994 (the "Conditions"). All defined terms in this Licence shall have the same meaning as in the Conditions.

The use of the Kitemark is authorized in respect of the Product(s), manufactured at, or provided from, the address above and in conformity with the standard(s) detailed on the following pages.

For and on behalf of BSI:

Anne Boyd, Managing Director, BSI Product Services



First granted: 18 Jan 2006

Date: 18 Jan 2006

Page: 1 of 3

The licence remains the property of BSI and shall be returned immediately upon request. This licence does not expire. To check its validity telephone: +44 (0)1442 230442
BSI is incorporated by Royal Charter



BSI Product Services

Maylands Avenue, Hemel Hempstead, Hertfordshire HP2 4SQ United Kingdom
Tel: +44 (0)1442 230442 Website: www.bsi-global.com

BSI Group Headquarters: 389 Chiswick High Road, London W4 4AL Tel: +44 (0)208 996 9000

PS027/0605/EP

Kitemark Licence



No. KM 70734

Yorkshire Copper Tube

Merseyside


BS EN 13348: 2001 : Copper and copper alloys – Seamless, round copper tubes for medical gases or vacuum

Certified Products

Outside Diameter (mm)	Wall Thickness (mm)	Temper
12	0.6, 0.8	R250
15	0.7, 1.0	R250
22	0.9, 1.2	R250
28	0.9, 1.2	R250
35	1.2	R250
42	1.2	R250
54	1.2	R250
35	1.2, 1.5	R290
42	1.2, 1.5	R290
54	1.2, 2.0	R290

Tubes will be marked with the following:

R250 (Half Hard)

YORKSHIRE EN 13348, OD x WALL, KITEMARK, , MONTH AND YEAR

First granted: 18 Jan 2006

Date: 18 Jan 2006

Page: 2 of 3

The licence remains the property of BSI and shall be returned immediately upon request. This licence does not expire. To check its validity telephone: +44 (0)1442 230442
BSI is incorporated by Royal Charter



BSI Product Services

Maylands Avenue, Hemel Hempstead, Hertfordshire HP2 4SQ United Kingdom
Tel: +44 (0)1442 230442 Website: www.bsi-global.com

BSI Group Headquarters: 389 Chiswick High Road, London W4 4AL Tel: +44 (0)208 996 9000

PS027/0605/EP

Kitemark Licence



No. KM 70734

Yorkshire Copper Tube

Merseyside

R290 (Hard)

YORKSHIRE EN 13348, OD x WALL, KITEMARK, MONTH AND YEAR

Additional product brand references may be included

First granted: 18 Jan 2006

Date: 18 Jan 2006

Page: 3 of 3

The licence remains the property of BSI and shall be returned immediately upon request. This licence does not expire. To check its validity telephone: +44 (0)1442 230442

BSI is incorporated by Royal Charter



BSI Product Services

Maylands Avenue, Hemel Hempstead, Hertfordshire HP2 4SQ United Kingdom

Tel: +44 (0)1442 230442 Website: www.bsi-global.com

BSI Group Headquarters: 389 Chiswick High Road, London W4 4AL Tel: +44 (0)208 996 9000

PS027/0605/EP

Certificate

EC-CERTIFICATE OF CONFORMITY

0086-CPD-550387



In compliance with the Directive 89/106/EEC of the Council of European Communities of 21 December 1988 on the approximation of laws, regulations and administrative provisions of the Member States relating to the construction products (Construction Products Directive - CPD), amended by the Directive 93/68/EEC of the Council of European Communities of 22 July 1993, it has been stated that the construction product

Copper and Copper Alloys – Seamless Round Copper Tubes for Water and Gas in Sanitary and Heating Applications

as detailed on the Supplementary Information Sheet

Produced in the factory &
placed on the market by

Yorkshire Copper Tube
Division of KME Yorkshire Ltd
East Lancashire Road
Kirkby
L33 7TU
United Kingdom

is submitted by the manufacturer to a factory production control and to the further testing of samples taken at the factory in accordance with a prescribed test plan and that the approved body British Standards Institution has performed the initial type-testing for the relevant characteristics of the product, the initial inspection of the factory and of the factory production control and performs the continuous surveillance, assessment and approval of the factory production control.

This certificate attests that all provisions concerning the attestation of conformity and the performances described in Annex ZA of the standard

EN 1057:2006

were applied and that the product fulfils all the prescribed requirements.

For and on behalf of the British Standards Institution, a Notified Body for the above Directive
(Notified Body Number 0086):

David Ford, Director, Healthcare and Testing Services

Date 21 September 2009

This certificate first issued Date 21 September 2009

This certificate remains valid as long as the conditions laid down in the harmonised technical specification in reference or the manufacturing conditions in the factory or the factory product control itself are not modified significantly.

The British Standards Institution is incorporated by Royal Charter.

raising standards worldwide™



Page 1 of 3

The British Standards Institution, trading as BSI, a company incorporated in the United Kingdom by Royal Charter and with its place of business at Kitemark House, Maylands Avenue, Hemel Hempstead HP2 4SQ United Kingdom Tel: +44 (0)8450 765600 Web: www.bsigroup.com. BSI Group Headquarters: 389 Chiswick High Road, London W4 4AL Tel: +44 (0)20 8996 9000. PS1023/0509/AP

Certificate

EC-CERTIFICATE OF CONFORMITY

0086-CPD-550387

SUPPLEMENTARY INFORMATION SHEET

Yorkshire Copper Tube
Division of KME Yorkshire Ltd, East Lancashire Road, Kirkby,
L33 7TU, United Kingdom

Diameter (mm)	Wall Thickness (mm)	Temper
8	0.6	R220
10	0.7	R220
6	0.6	R250
6	0.8	R250
8	0.6	R250
8	0.8	R250
10	0.6	R250
10	0.8	R250
12	0.6	R250
12	0.8	R250
12	1.0	R250
14.7	0.7	R250
15	0.7	R250
15	1.0	R250
18	1.0	R250
21	0.9	R250
22	0.9	R250
22	1.0	R250
22	1.2	R250
27.4	0.9	R250
28	0.9	R250
28	1.2	R250
28	1.5	R250
34	1.1	R250
35	1.2	R250
40.5	1.1	R250
42	1.2	R250
53.6	1.2	R250
54	1.2	R250

raising standards worldwide™

21/09/2009

Page 2 of 3



The British Standards Institution, trading as BSI, a company incorporated in the United Kingdom by Royal Charter and with its place of business at Kitemark House, Maylands Avenue, Hemel Hempstead HP2 4SQ
United Kingdom Tel: +44 (0)8450 765600 Web: www.bsigroup.com. BSI Group Headquarters: 389 Chiswick High Road, London W4 4AL Tel: +44 (0)20 8996 9000.

P51023/0509/AP

Certificate

EC-CERTIFICATE OF CONFORMITY

0086-CPD-550387

SUPPLEMENTARY INFORMATION SHEET

Yorkshire Copper Tube
Division of KME Yorkshire Ltd, East Lancashire Road, Kirkby,
L33 7TU, United Kingdom

Diameter (mm)	Wall Thickness (mm)	Temper
8	0.8	R290
10	0.8	R290
12	1	R290
15	1	R290
18	1	R290
22	1	R290
28	1	R290
28	1.2	R290
28	1.5	R290
35	1	R290
35	1.2	R290
35	1.5	R290
42	1	R290
42	1.2	R290
42	1.5	R290
54	1	R290
54	1.2	R290
54	1.5	R290
54	2	R290
64	2	R290
66.7	1.2	R290
66.7	2	R290
70	2	R290
76.1	1.5	R290
76.1	2	R290
88.9	2	R290
108	1.5	R290
108	2	R290
108	2.5	R290

raising standards worldwide™

21/09/2009

Page 3 of 3



The British Standards Institution, trading as BSI, a company incorporated in the United Kingdom by Royal Charter and with its place of business at Kitemark House, Maylands Avenue, Hemel Hempstead HP2 4SQ United Kingdom Tel: +44 (0)8450 765600 Web: www.bsigroup.com. BSI Group Headquarters: 389 Chiswick High Road, London W4 4AL Tel: +44 (0)20 8996 9000. PS1023/0509/AP

Section 7 – Guarantee

7.1 25 Year Guarantee

YORKSHIRE COPPER TUBE

25 YEAR GUARANTEE

Yorkshire Copper Tube is a leading supplier of copper tube to the United Kingdom and many countries worldwide .

Yorkshire's factory situated on Merseyside is today one of the most modern tube-producing plants in the world. We employ advanced manufacture methods and sophisticated quality control techniques to ensure that consistently high standards are maintained.

A comprehensive technical advice service is freely available.

GUARANTEE

YORKSHIRE COPPER TUBE (hereafter called “YCT”) **HEREBY GUARANTEES** the goods purchased and fitted by the Installer on the undermentioned terms:-

1. **“The Goods”** shall mean:

- (a) “Yorkshire” plain copper tubes, supplied by **YCT**.
- (b) “Kuterlex” composite plastic covered copper tubes, supplied by **YCT**.
- (c) Chromium plated copper tubes, supplied by **YCT**.

2. **Liability**

In the event that, during a period of 25 years from the date of purchase by the installer, tube failure or other damage occurs when the Installer's customer uses the goods, as a direct consequence of:

- (a) Manufacturing defects in the goods; or
- (b) Material faults in the goods; or
- (c) Failure to comply with the prime requirements of the national/international standard marked on the goods

YCT undertakes:

- (i) To replace such faulty or defective goods free of charge;
- (ii) To pay the installer his reasonable charge for removing or replacing such faulty or defective goods up to a maximum of £75,000 per incident;
- (iii) To accept responsibility for the costs of remedying the said damage, to a maximum of £250,000 for each incidence of damage to persons and property for which **YCT** is legally liable.

When the extent of such damage has been established, **YCT** reserves the right either to repair the damage itself or to have it repaired at its expense by firms appointed by **YCT**.

3. **Obligations of the Installer**

It is a condition precedent to the coming into effect of this guarantee that the Installer shall:

- (a) ensure correct installation and assembly of the relevant pipe system in accordance with such standards and local Codes of Practice as are valid at the time of installation;
- (b) immediately implement all necessary measures to reduce damage;
- (c) notify the fault, defect or damage to **YCT** as soon as practicable after the fault, defect or damage has become apparent;
- (d) on request, make the goods available to **YCT** for inspection, and **YCT** shall have the opportunity to assess the damage itself or through experts and form its opinion thereon. Those parts of the goods which are responsible for the damage are always to be kept available for inspection until the final settlement of the relevant claim.

4. **Assignability**

The guarantee is personal to the installer and is not assignable. Save as aforesaid, transactions between **YCT** and the merchants concerned continue to be subject to our Standard Conditions of Sale.

30 Year Guarantee

The above guarantee is extended to 30 years where pipeline systems are constructed exclusively from Yorkshire copper tube and Xpress Copper, Xpress Gas, Tectite and Tectite Pro fittings from Pegler Yorkshire Ltd.

Section 8 – COSHH

8.1 MATERIAL SAFETY DATA SHEET

1. IDENTIFICATION OF THE SUBSTANCE AND COMPANY.

Identification of the substance.

Extruded, seamless copper tube.

Identification of the Company.

Yorkshire Copper Tube, East Lancashire Road, Kirkby,
Liverpool, Merseyside, United Kingdom. Post Code : L33 7TU.

2. COMPOSITION/INFORMATION.

Composition.

COMPONENT	%	EINECS NO.	SYMBOL	R-PHRASES	S-PHRASES
Copper	99.90 min.	231 - 159 - 6	N/A	N/A	N/A

Description.

This product is extruded as a seamless tube from solid copper.

3. HAZARDS IDENTIFICATION.

There are no hazards to health of humans in solid form.

In high concentrations copper oxide dust is a mechanical irritant to eyes and upper respiratory tract, causing symptoms similar to "metal fume fever", which may last up to 24 hours. There are no known permanent effects. However, when used in accordance with manufacturer's instructions no particulates should be generated.

4. FIRST AID MEASURES.

Inhalation : Extreme amounts of copper dust may be irritant to the upper respiratory tract. Remove to fresh air. Seek medical attention.

Skin Contact : Non-irritant. Rinse affected area with water as a precaution.

Eye Contact : Flush eyes with copious amounts of water. Seek medical attention.

Ingestion : Drink plenty of water.

5. FIRE FIGHTING MEASURES.

Copper is non-flammable and indeed does not melt below 1083 °C.

6. ACCIDENTAL RELEASE MEASURES.

Environmental Precautions.

Do not flush copper filings or copper oxide dust to drain. Prevent filings or dust from entering natural water courses.

7. **HANDLING AND STORAGE.**

Handling.

Under normal circumstances, may be handled without personal protective equipment, however, it is advisable to wear suitable cut-resistant gloves when cutting with a hacksaw.

Storage.

No special precautions are necessary. Store in a horizontal position, preferably indoors, to prevent ingress of dust, dirt etc.

8. **EXPOSURE CONTROLS/PERSONAL PROTECTION.**

COMPONENT	CAS NO.	EINECS NO.	LTEL (8 hours)	R-PHRASE	STEL (15 mins.)
Copper fume	7440 - 50 - 8	231 - 159 - 6	0.2 mg/m ³	N/A	----
Copper dust/mist	7440 - 50 - 8		1 mg/m ³		2 mg/m ³

LTEL = Long term exposure limit.

STEL = Short term exposure limit

Engineering Measures.

Not applicable.

Respiratory Protection.

Not necessary when used in accordance with manufacturer's instructions.

Eye Protection.

During cutting and soldering operations, eye protection to BS EN 166 should be worn.

Skin Protection.

During cutting and soldering operations, it is recommended that suitable hand protection is worn.

9. **PHYSICAL AND CHEMICAL PROPERTIES.**

COLOUR	Red/brown	MATERIAL STATE	Solid
ODOUR	None	MELTING POINT	1083°C
DENSITY	8.93g/cm ³	FLAMMABILITY	None

10. **STABILITY AND REACTIVITY.**

Stability.

Fully stable.

Conditions To Avoid.

Excessive exposure to the elements will result in formation of a protective oxide layer which nevertheless gives the material a surface tarnish. In potentially corrosive environments protection of the pipework may be afforded by the use of a factory-applied, plastics covering (refer to manufacturer for further details).

Hazardous Decomposition Products.

None.

11. TOXICOLOGICAL INFORMATION.

EEC Substance/Preparation Toxicity Classification.

Oral LD50 (Rat)
Dermal LD50 (Rabbit)
Inhalation LC50 (4 Hr. Rat)
Skin Irritation (Rabbit)
Eye Irritation (Rabbit)
Dermal Sensitisation
Inhalation Sensitation
AMES Test

Not classified under any of the above.

Potential Health Effects.

The product is entirely suitable for use in conjunction with potable (i.e. drinking) waters.

Hazardous Ingredients Toxicity Data.

None.

12. ECOLOGICAL INFORMATION.

Copper in large quantities may cause pollution of the water course with subsequent deterioration of water quality which may cause harm to aquatic life forms. However, the human body requires 2.5 to 5.0 mg of copper per day to maintain health. Copper is an essential trace element in maintaining the general well-being of humans.

13. DISPOSAL CONSIDERATIONS.

Copper is a fully recyclable metal and therefore no waste should ensue from its use. Where scrap is generated, local non-ferrous scrap handlers should be contacted.

14. TRANSPORT INFORMATION.

Copper is a non-regulated material by land, sea or air.

15. REGULATORY INFORMATION.

EEC Marking And Labelling.

Not applicable.

16. OTHER INFORMATION.

None.

This page has been intentionally left blank

Section 9 – References

- (1) HSE Approved Code of Practice, L8, *"The Control of Legionella Bacteria in Water Systems"*.
<http://www.hse.gov.uk/pubns/priced/l8.pdf>
- (2) BS EN 806-4: 2010, *"Specifications for installations inside buildings conveying water for human consumption – Part 4: Installation"* (3) BS EN 14336:2004, *"Heating systems in buildings. Installation and commissioning of water-based heating systems"*.
- (4) BS 5431:1976, *"Specification for Bending Springs for use with Copper Tubes for Water, Gas and Sanitation"*.
- (5) BS EN 1057:2006, *"Copper and copper alloys - Seamless, round copper tubes for water and gas in sanitary and heating applications"*.
- (6) BS EN 1254-1:1998, *"Copper and copper alloys - Plumbing fittings - Part 1: Fittings with ends for capillary soldering or capillary brazing to copper tubes"*.
- (7) BS EN 1254-2:1998, *"Copper and copper alloys - Plumbing fittings - Part 2: Fittings with compression ends for use with copper tubes"*.
- (8) BS EN 1254-4:1998, *"Copper and copper alloys - Plumbing fittings - Part 4: Fittings combining other end connections with capillary or compression ends"*.
- (9) BS EN 1254-5:1998, *"Copper and copper alloys - Plumbing fittings - Part 5: Fittings with short ends for capillary brazing to copper tubes"*.
- (10) BS EN 1254-6: 2012, *"Copper and copper alloys - Plumbing fittings - Part 6: Fittings with push-fit ends"*.
- (11) BS EN 8537: 2010, *"Copper and copper alloys - Plumbing fittings - Specification for press ends of plumbing fittings for use with metallic tubes"*.
- (12) Copper Development Association Publication 33, *"Copper Tube in Domestic Water Services, Design and Installation"*.
- (13) BS 5422:2009 *"Methods for specifying thermal insulation materials on pipes, ductwork and equipment in the temperature range -40 to +700°C"*
- (14) BS EN 1976:2012, *"Copper and copper alloys - Cast unwrought copper products"*.
- (15) BS EN 1173:2008, *"Copper and copper alloys - Material condition or temper designation"*.
- (16) BS EN 13349:2002, *"Copper and copper alloys - Pre-insulated copper tubes with solid covering"*.
- (17) BS 1710:1984, *"Identification of pipelines and services"*.
- (18) BS 4800:2011 *"Schedule of paint colours for building purposes"*.
- (19) BS EN ISO 1456: 2009, *"Metallic and other inorganic coatings. Electrodeposited coatings of nickel, nickel plus chromium, copper plus nickel and copper plus nickel plus chromium"*.
- (20) HTM 02-01:2006, *"Medical gas pipeline systems Part A Design, Installation, Validation and Verification"*.
- (21) BS EN 13348:2008, *"Copper and copper alloys – Seamless round copper tubes for medical gases or vacuum"*.
- (22) BS 1306:1975, *"Copper and copper alloy pressure piping systems"*.